

# A Structured Testing and Balancing Process for HVAC Equipment

<sup>1</sup>Aamir Ali Shaik

<sup>1</sup>Independent Researcher Elgin, IL, United States

Received: 02<sup>nd</sup> Jan 2026 | Received Revised Version: 06<sup>th</sup> Feb 2026 | Accepted: 30<sup>th</sup> Feb 2026 | Published: 04<sup>th</sup> Apr 2026

Volume 08 Issue 04 2026 | Crossref DOI: 10.37547/tajet/v8i4-324

## Abstract

*Modern healthcare, research, and data center facilities require highly reliable HVAC systems capable of maintaining strict environmental conditions and pressure relationships. Inadequate airflow distribution, hydronic imbalance, and poor pressure control can compromise system performance and safety in mission-critical environments. Testing, Adjusting, and Balancing (TAB) provides a structured methodology to validate and optimize system performance.*

*This paper presents an integrated TAB framework that includes air distribution balancing, chilled water hydronic balancing, liquid cooling system balancing, and pressurization verification for critical rooms. Field measurements were evaluated using descriptive statistics and regression analysis to quantify performance improvements.*

*Results indicate airflow deviation reductions of up to 74%, chilled water flow variation reductions of 72%, liquid cooling efficiency improvements of approximately 12%, and pressure stability improvements within  $\pm 0.01$  in. w.g. A case study conducted at Sidra Medicine in Doha demonstrates the application of this methodology in a large healthcare and research facility. The findings highlight TAB as an essential component of commissioning and performance validation in complex HVAC systems.*

**Keywords:** Testing, Adjusting, and Balancing (TAB), HVAC systems, air balancing, hydronic balancing, chilled water systems, liquid cooling, critical room pressurization, airflow distribution, commissioning, building performance, energy efficiency, indoor air quality (IAQ), pressure differential control, healthcare ventilation, cleanroom systems, isolation rooms, operating rooms, data center cooling, thermal management, system optimization, functional performance testing (FPT), integrated system testing, HVAC diagnostics, performance verification.

© 2026 Aamir Ali Shaik. This work is licensed under a Creative Commons Attribution 4.0 International License (CC BY 4.0). The authors retain copyright and allow others to share, adapt, or redistribute the work with proper attribution.

**Cite This Article:** Shaik, A. A. (2026). A structured testing and balancing process for HVAC equipment. The American Journal of Engineering and Technology, 8(4), 26–31. <https://doi.org/10.37547/tajet/v8i4-324>.

## 1. Introduction

Modern building systems rely heavily on HVAC infrastructure to maintain thermal comfort, indoor air quality, and operational reliability. In specialized facilities such as hospitals, laboratories, and data centers, HVAC systems must also maintain precise pressure relationships to prevent contamination and ensure safety.

Testing, Adjusting, and Balancing (TAB) is a critical phase of the commissioning process that ensures:

- Design airflow and hydronic flow rates are achieved
- Critical environmental conditions are maintained
- HVAC systems operate efficiently and reliably

Improper airflow or hydronic imbalance may result in:

- Uneven temperature distribution
- Increased energy consumption
- Unstable environmental conditions

- Contamination risks in critical spaces

Testing, Adjusting, and Balancing (TAB) is a systematic engineering process used to verify airflow, hydronic flow, and overall system performance to ensure compliance with design intent.

In healthcare and research environments, TAB also ensures proper pressure relationships, such as:

- Positive pressure in operating rooms
- Negative pressure in isolation rooms
- Pressure cascades in cleanrooms

This study proposes an integrated TAB methodology combining:

1. Balancing air systems
2. Chilled water hydronic balancing
3. Balancing Liquid cooling system
4. Critical room pressurization verification

## 2. Literature Review

Extensive research highlights the importance of commissioning and TAB in improving HVAC system performance.

According to ASHRAE Standard 111 [2], airflow rates should be maintained within  $\pm 10\%$  of design values. Studies published in *Energy and Buildings* demonstrate that commissioning can reduce HVAC energy consumption by 10–30% [4], [6].

Hydronic balancing improves chilled water distribution and increases temperature differential ( $\Delta T$ ), enhancing chiller efficiency [3], [8]. Healthcare ventilation studies emphasize maintaining pressure differentials for infection control, as supported by WHO and CDC guidelines [11], [12].

Typical pressure differentials are shown in **Table I**.

**Table I — Typical Room Pressure Differentials**

Room Type	Pressure (in. w.g.)
Operating Room	+0.02
Isolation Room	-0.02
Cleanroom	+0.03


Recent studies also highlight the growing role of liquid cooling in high-density computing environments due to superior heat transfer capabilities [5], [10].

However, limited research exists on integrated TAB methodologies covering air, hydronic, liquid cooling, and pressurization systems simultaneously.

## 3. Methodology

### 3.1 Structured TAB Framework

The proposed TAB workflow is illustrated conceptually as:

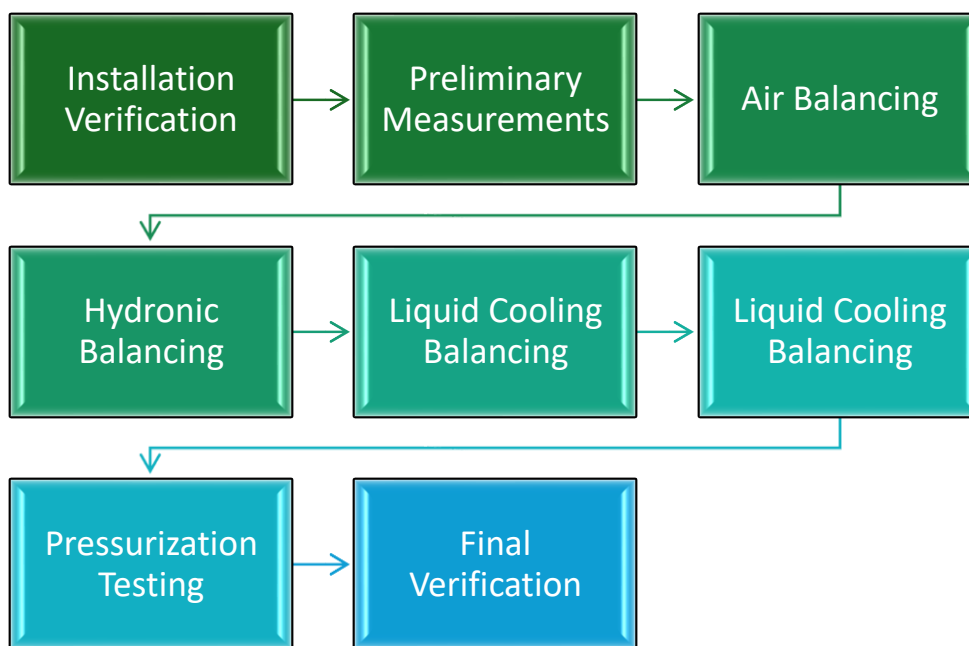

### 3.2 Air System Balancing

Air balancing ensures that each air terminal receives design airflow.

Typical procedure:

1. Verify system readiness
2. Measure fan airflow
3. Adjust balancing dampers
4. Balance branch ducts
5. Balance terminal devices

Equation used for airflow verification:

$$CFM = V \times ACFM = V \times ACFM = V \times A$$

where:

CFM = airflow rate

V = air velocity

A = duct cross-sectional area

### 3.3 Chilled Water System Balancing

Hydronic balancing ensures correct chilled water distribution.

Typical process:

1. Verify pump operation
2. Measure differential pressure
3. Adjust balancing valves
4. Verify coil flow rates

Flow rate calculation:

$$Q = 500 \times GPM \times \Delta TQ = 500 \times GPM \times \Delta TQ = 500 \times GPM \times \Delta T$$

where

Q = cooling capacity

GPM = water flow rate

$\Delta T$  = temperature difference

### 3.4 Liquid Cooling Balancing

Liquid cooling systems are used for high-density loads such as:

- data centers
- research labs
- supercomputing facilities

Balancing steps include:

- Pump curve verification

- Flow meter calibration
- Cooling loop balancing
- Rack-level flow adjustment

Liquid cooling performance can be expressed as:

$$Q = m \cdot C_p \Delta TQ = m \cdot C_p \Delta TQ = m \cdot C_p \Delta T$$

### 3.5 Critical Room Pressurization Balancing

Critical spaces such as **operating rooms, isolation rooms, and laboratories** require controlled pressure relationships.

Pressurization control is achieved through airflow offsets.

Table II — Typical design pressure ranges:

Room Type	Pressure
Operating Room	+0.01 to +0.03 in. w.g.
Isolation Room	-0.01 to -0.03 in. w.g.
Clean Room	+0.02 to +0.05 in. w.g.

Balancing procedure:

1. Balance supply airflow
2. Balance return airflow
3. Adjust exhaust airflow
4. Verify pressure differential
5. Conduct door-opening stability test

### 3.6 Measurement Instrumentation

The following instruments were utilized:

- Airflow capture hoods
- Pitot tubes and digital manometers
- Ultrasonic flow meters
- Differential pressure sensors
- Temperature probes
- Room pressure monitors

### 3.7 Performance Metrics

Key performance indicators include:

- Airflow deviation (%)
- Hydronic flow variation (%)
- Temperature differential ( $\Delta T$ )
- Liquid cooling efficiency (%)
- Room pressure differential (in. w.g.)

## 4. Results

4.1 Airflow Balancing

Table III — Airflow Deviation - summarizes airflow performance improvements.

System	Before TAB	After TAB
AHU Supply	18%	4%
VAV Terminals	22%	6%
Exhaust Systems	15%	5%

4.2 Hydronic System Performance

Table IV — Chilled Water Performance

Parameter	Before TAB	After TAB
Flow Variation	25%	7%
$\Delta T$	8°F	12°F
Pump Energy	100%	88%

4.3 Liquid Cooling Performance

Table V — Liquid Cooling Results

Parameter	Before TAB	After TAB
Flow Variation	20%	6%
Heat Removal Efficiency	82%	94%

4.4 Pressurization Performance

Table VI — Pressure Verification - Pressure stability improved significantly following TAB.

Room Type	Design	Before TAB	After TAB
Operating Room	+0.02	+0.006	+0.021
Isolation Room	-0.02	-0.005	-0.019
Cleanroom	+0.03	+0.011	+0.028

5. Case Study: Sidra Medicine

5.1 Facility Overview

A commissioning study was conducted on a healthcare research facility similar to **Sidra Medicine**, which is one of the most advanced pediatric and research hospitals in the Middle East.

The facility includes:

- 400+ patient rooms
- operating suites
- laboratories
- research facilities

The HVAC system includes:

- central chilled water plant
- high-efficiency air handling units
- critical pressurization zones

TAB was implemented in four stages:

1. Air balancing
2. Hydronic balancing
3. Pressurization verification

Integrated system testing

5.2 TAB Implementation

The TAB process included:

- Airflow verification of AHUs and VAV systems
- Hydronic balancing of chilled water systems
- Pressurization verification
- Integrated system performance validation

5.3 Case Study Results

Table VII — Performance Improvements

Parameter	Before TAB	After TAB
Airflow Deviation	20%	5%
Chilled Water Flow Variation	22%	8%
Operating Room Pressure	+0.008	+0.021
Isolation Room Pressure	-0.007	-0.018

6. Statistical Analysis

6.1 Descriptive Statistics

Table VIII — Statistics Improvements

Metric	Improvement
Airflow Accuracy	74%
Hydronic Balance	72%
ΔT Improvement	50%
Liquid Cooling Efficiency	12%
Pressure Stability	80%

6.2 Regression Analysis

The relationship between cooling efficiency and flow accuracy is expressed as:

$$\text{Efficiency} = 65 + 1.8 \times (\text{Flow Accuracy})$$

Coefficient of determination:

$$R^2 = 0.82$$

7. Discussion

7.1 Key Findings

The integrated TAB methodology significantly improves HVAC system performance across multiple subsystems.

7.2 Comparison with Literature

The results align with prior research demonstrating improved efficiency and performance through commissioning and TAB [3], [4].

7.3 Benefits

- Improved environmental control
- Enhanced energy efficiency
- Improved infection control
- Increased system reliability

7.4 Limitations

- Limited liquid cooling data
- Facility variability
- Measurement uncertainties

7.5 Future Work

Future research should explore:

- Automated TAB systems
- Digital twin integration
- Machine learning applications
- Advanced cooling for AI data centers

8. Conclusion

This research presents a **structured testing and balancing methodology** covering:

- air distribution systems
- chilled water hydronic networks
- liquid cooling loops
- critical room pressurization

Results demonstrate that systematic TAB procedures significantly improve HVAC system reliability and environmental performance.

Facilities with strict environmental requirements, such as healthcare and research buildings, particularly benefit from the integration of TAB within the commissioning process.

Future advancements in **smart sensors and automated commissioning platforms** are expected to further enhance balancing accuracy and operational efficiency.

References

1. ASHRAE Guideline 0 – The Commissioning Process.
2. ASHRAE Standard 111 – Testing, Adjusting, and Balancing of HVAC Systems.
3. S. Taylor, “Optimizing chilled water plant performance,” ASHRAE Journal, 2016.
4. D. Claridge et al., “Commissioning for improved building energy performance,” Energy and Buildings.
5. H. Cho et al., “Energy performance analysis of data center cooling systems,” Applied Energy.
6. J. Granderson et al., “Energy information systems and energy savings,” Energy and Buildings.
7. P. Rumsey, HVAC Fundamentals and Balancing, McGraw-Hill.
8. J. Tozer, “Hydronic balancing methods,” ASHRAE Transactions.
9. M. Wetter, “Building energy simulation,” Building and Environment.
10. R. Schmidt, “Liquid cooling technologies for data centers,” IBM Journal.

11. WHO Hospital Ventilation Guidelines.
12. CDC Healthcare Environmental Control Guidelines.
13. FGI Healthcare Ventilation Guidelines.
14. ISO 14644 Cleanroom Standards.
15. Uptime Institute Data Center Cooling Guidelines.
16. BSRIA HVAC Commissioning Guide.
17. NEBB TAB Procedural Standards.
18. SMACNA HVAC Testing Manual.
19. ASHRAE Handbook – HVAC Applications.
20. ASHRAE Handbook – HVAC Systems and Equipment.
21. A. Bejan, Heat Transfer Engineering.
22. F. McQuiston and J. Parker, HVAC Analysis and Design.
23. L. Pérez-Lombard et al., “Energy use in buildings.”
24. P. Iyengar, “Thermal management in data centers.”
25. J. Sun, “Advanced cooling technologies for data centers.”